

SHEET PILING TO SPECIALIST CONTRACTOR'S DETAIL. CONTRACTOR TO BE FULLY RESPONSIBLE FOR ALL ASPECTS OF DESIGN OF SHEET PILING AND ITS WORKS.


DROP PAD FOOTING PF1 SUCH THAT A 1:1 LINE FROM THE BASE OF FOOTING DOES NOT INTERSECT RW1 AT ANY POINT.

WIDEN RW1 TO MATCH WALL OVER.

BUILDER'S NOTE: BEAR SF1 150mm MIN. ONTO RW1 (TYPICAL).

BUILDER'S NOTE: BRICK PIER TO HAVE 3N16 RODS 800MIN. INTO POOL WALL, 1200 STARTER BAR LAP. COG 300 INTO SUSPENDED SLAB OVER.

LINTEL SCHEDULE 1:20

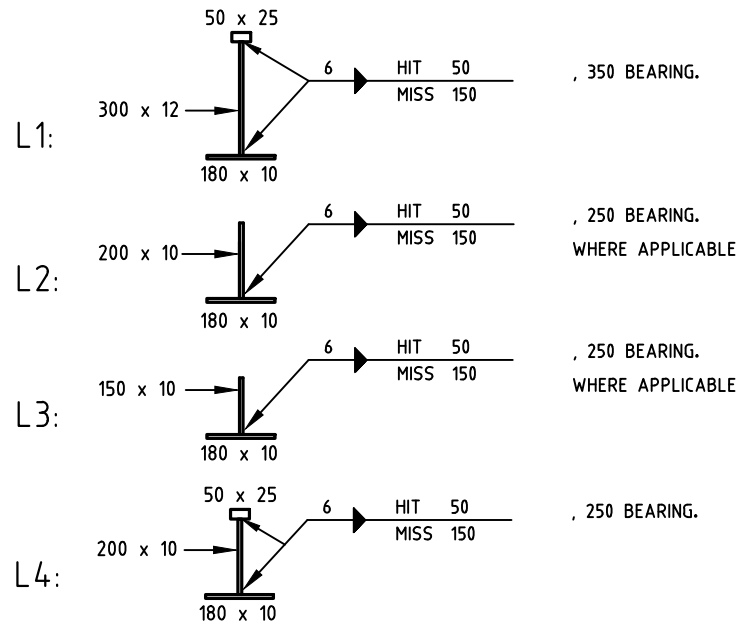

- INSTALL 2 L6 GALV. RODS IN FIRST TWO BED JOINTS OF EACH LEAF OF BRICKWORK ABOVE LINTEL (LAP 500 WHERE REQ'D) 20 SIDE COVER.
- 200 x 10 PL AT 230 WALL.
- INTERSECTING LINTELS TO BE MITRE CUT AND FULLY WELDED AT CORNER

FOOTING & GROUND SLAB PLAN 1:100

- PROVIDE 100mm GROUND SLAB REINFORCED WITH SL62 FABRIC, 25mm TOP COVER U.N.O. LAP 225mm MIN. WHERE REQUIRED.
 - INDICATES WET AREAS SET DOWN 40mm FOR TILING AND FALLS, MAINTAIN 100mm SLAB THICKNESS. (SHOWN HATCHED) CRANK MESH 1 : 6 OR LAP 225mm MIN
 - INDICATES 50mm SETDOWN FOR SHOWER.
 - PROVIDE 2-N16 x 1500 LONG RE-ENTRANT BAR TIED UNDER MESH AT ALL RE-ENTRANT CORNERS.
 - PF1 - 1200 x 1200 x 300 DEEP, UNREINFORCED
 - PF2 - 850 x 850 x 300 DEEP, UNREINFORCED
 - PF3 - 950 x 950 x 300 DEEP, UNREINFORCED
 - PF4 - 700 x 500 x 300 DEEP, UNREINFORCED
 - PF5 - 500 x 500 x 300 DEEP, UNREINFORCED
 - C1 - 65 x 65 x 4.0 RHS (SEE COLUMN C1 DETAIL ON SHEET 11)
 - C2 - 150 x 150 x 4.0 SHS (SEE COLUMN C2 DETAIL ON SHEET 11)
 - C3 - 50 x 50 x 3.0 SHS (SEE COLUMN C3 DETAIL ON SHEET 11)
 - C4 - 150 x 50 x 4.0 RHS (SEE COLUMN C4 DETAIL ON SHEET 11)
 - C5 - 75 x 75 x 4.0 SHS (SEE COLUMN C5 DETAIL ON SHEET 11)
 - C6 - 75 x 75 x 4.0 SHS (SEE COLUMN C6 DETAIL ON SHEET 11)
 - C7 - 50 x 50 x 3.0 SHS (SEE COLUMN C7 DETAIL ON SHEET 11)
 - C8 - 65 x 65 x 4.0 SHS (SEE COLUMN C8 DETAIL ON SHEET 12)
 - C9 - 150 x 150 x 4.0 SHS (SEE COLUMN C9 DETAIL ON SHEET 12)
 - C10 - 50 x 50 x 3.0 SHS (SEE COLUMN C10 DETAIL ON SHEET 12)
 - C11 - 150 x 50 x 4.0 RHS (SEE COLUMN C11 DETAIL ON SHEET 12)
 - C12 - 100 x 50 x 4.0 RHS (SEE COLUMN C12 DETAIL ON SHEET 12)
 - C13 - 150 x 50 x 6.0 RHS (SEE COLUMN C13 DETAIL ON SHEET 12)
 - C14 - 100 x 100 x 3.0 SHS (SEE STAIR 3 ELEVATION DETAIL ON SHEET 9)
- ALL COLUMNS IN BRICK CAVITY WALL TO HAVE R6 ROD HIT (50) AND MISS (400) WELDED TO COLUMN. FIX STANDARD Ø 3.15 WIRE TIES AT 343 CRS MAX-TYPICAL

Robert David
MIEAust CPEng
Chartered Professional Engineer
Membership No. 259960
The Institution of Engineers, Australia

 ADVANCED BUILDING ENGINEERS PTY LTD <small>ABN 63 120 673 832 ACN 120 673 832</small> 632 NEWCASTLE STREET, LEEDERVILLE, WA 6007. T. 08 9228 4644, F. 08 9328 2937 www.abewa.com.au	PROJECT	
	DRAWN	APPROVED BY:
DRAWING TITLE FOOTING & GROUND SLAB PLAN	DESIGNED	SHEET S1
	CHECKED	REV 5
	SCALE: 1:100	