






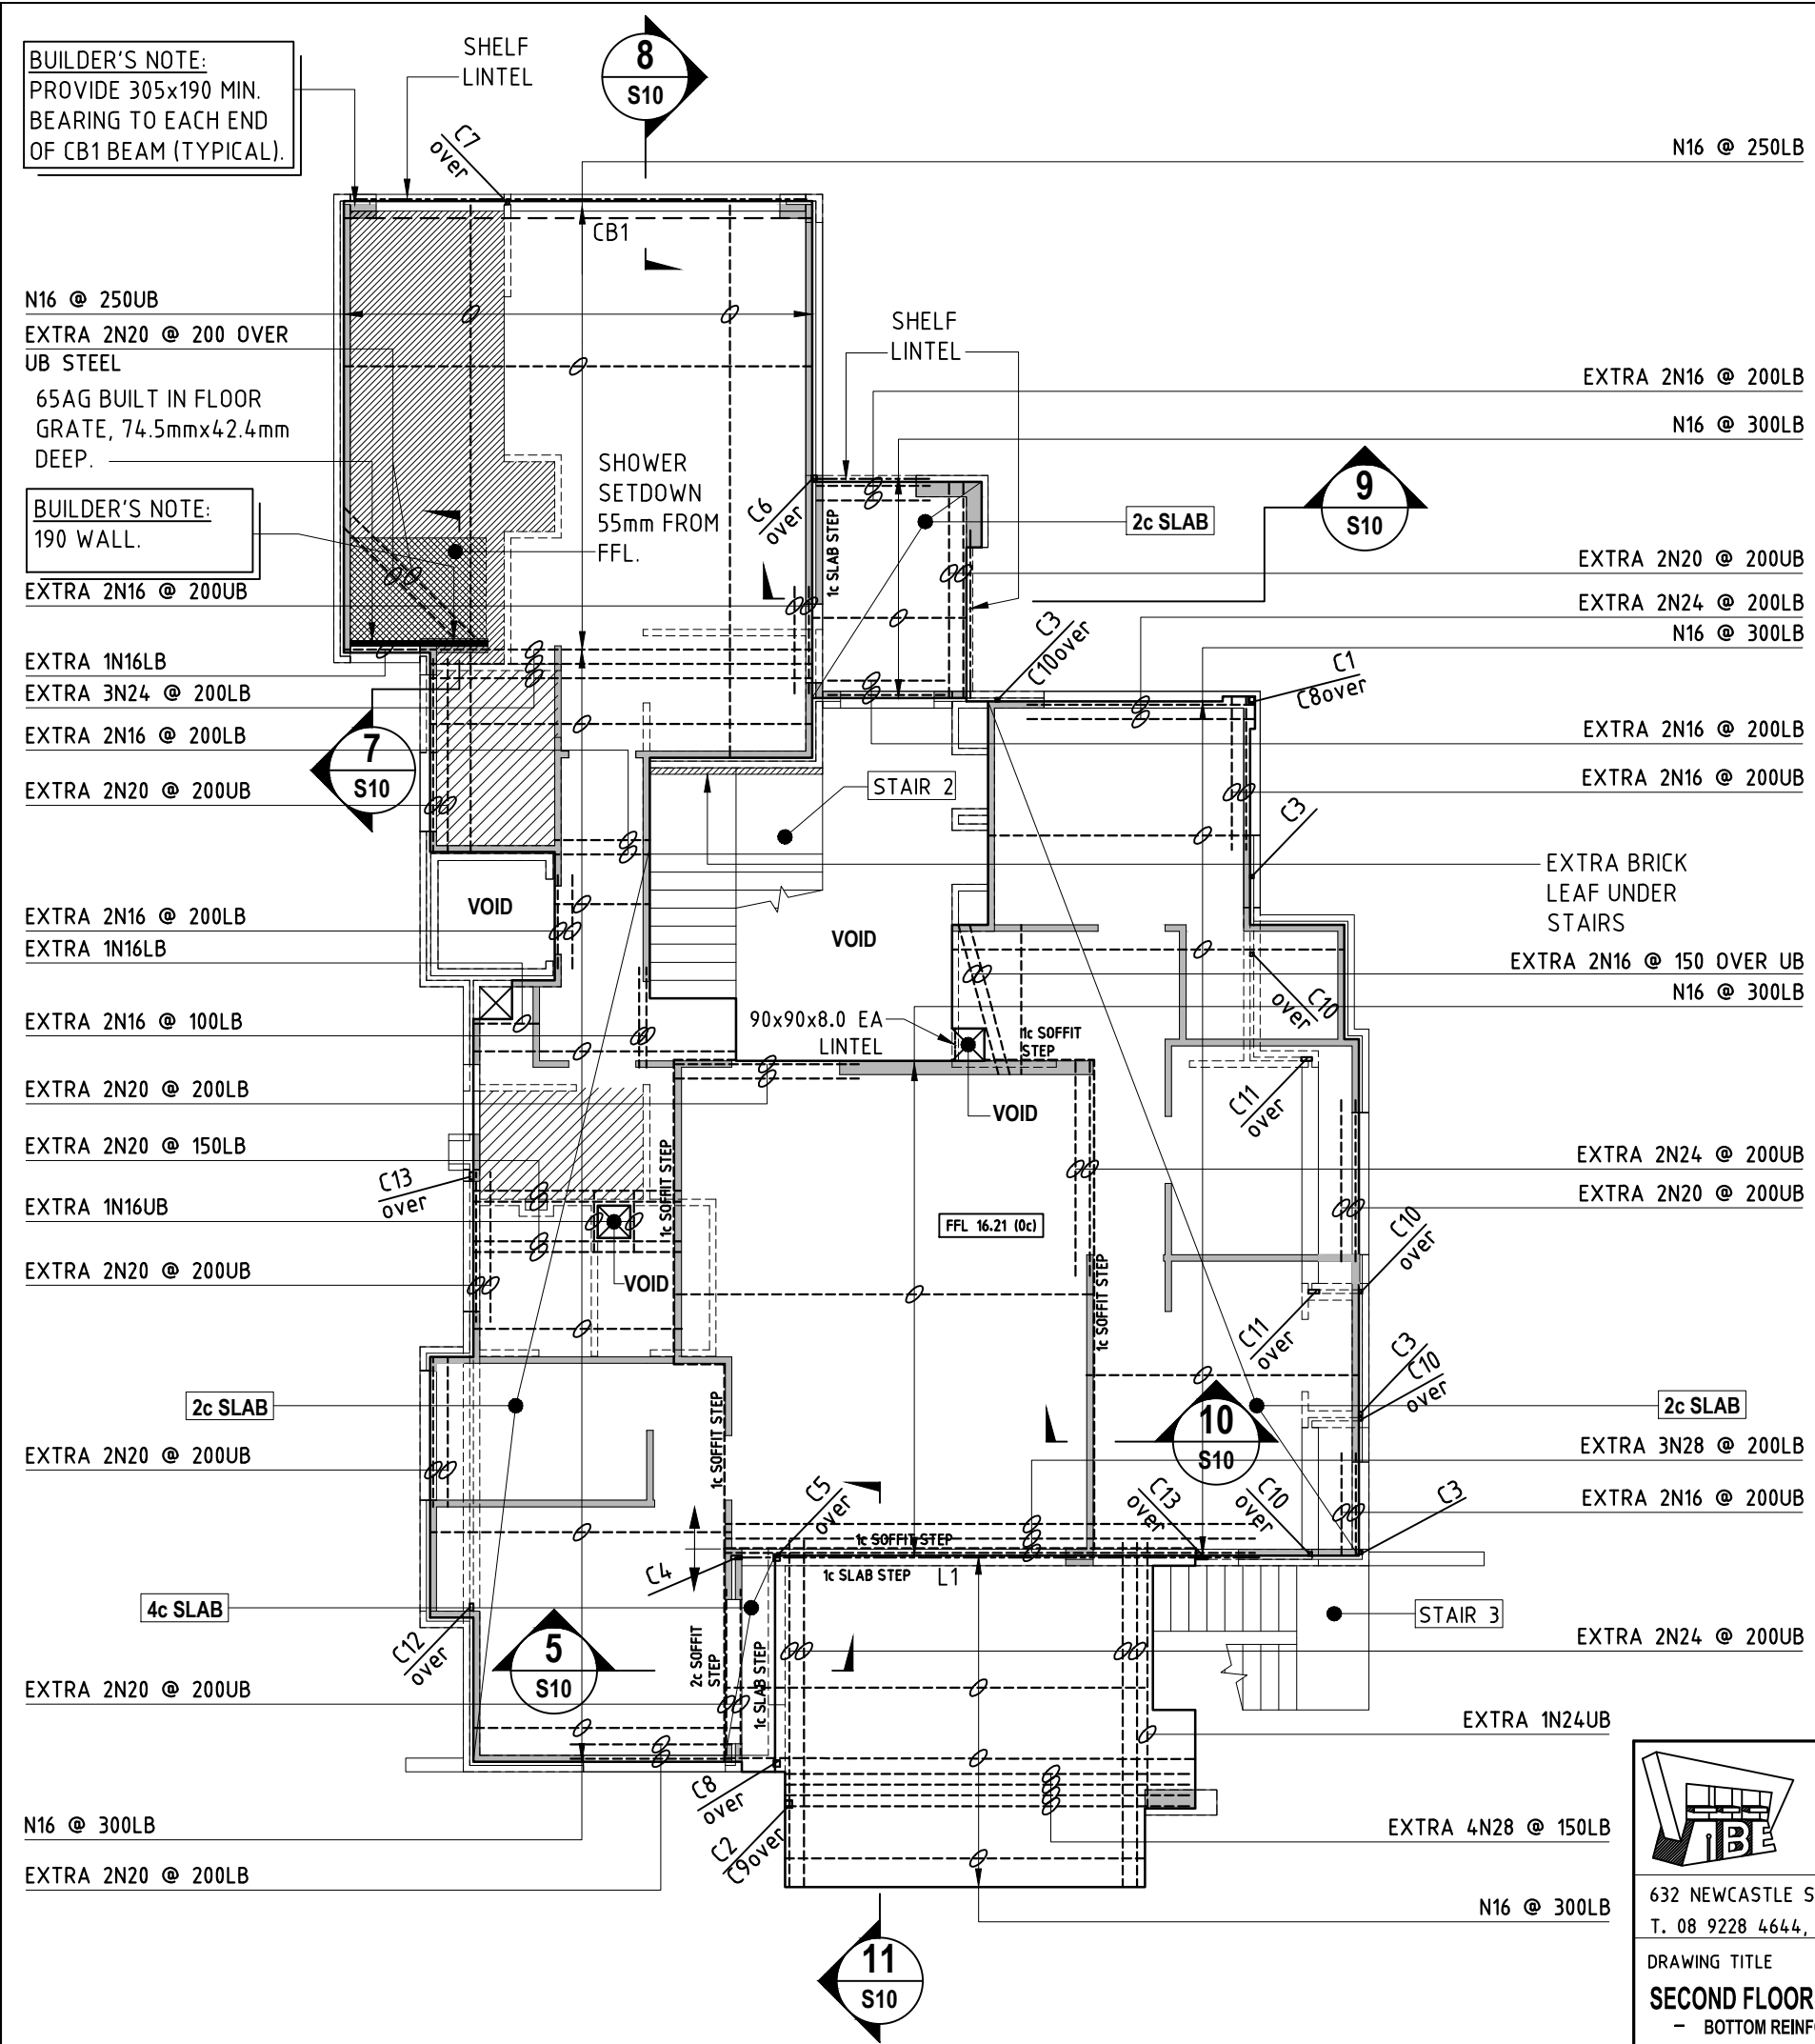
BUILDER'S NOTE:
PROVIDE 305x190 MIN. BEARING TO EACH END OF CB1 BEAM (TYPICAL).

BUILDER'S NOTE:
190 WALL.

BOTTOM REINFORCEMENT 40MPa CONCRETE

SECOND FLOOR SUSPENDED SLAB PLAN 1:100

1. MINIMUM SLAB THICKNESS 257mm UNLESS NOTED OTHERWISE
- 2a.  INDICATES WET AREAS SETDOWN 30mm FOR TILING & FALLS.
- 2b.  INDICATES 50mm SETDOWN TO SHOWER.
3. DISTRIBUTION REINFORCEMENT, UNO: 172: N12 @ 300 UB
4.  INDICATES BOTTOM REINFORCEMENT
5.  INDICATES LOAD BEARING BRICKWORK
6.  INDICATES BRICKWORK ABOVE SLAB
6. FOR CONCRETE NOTES REFER TO COVER SHEET.
7. LB-LOWER BOTTOM REINFORCEMENT
UB-UPPER BOTTOM REINFORCEMENT
8. FOR COLUMN SIZE REFER TO SHEET 1
COLUMN SHOWN AS UNDER UNLESS NOTED OTHERWISE.



Robert David
MIEAust CPEng
Chartered Professional Engineer
Membership No. 259960
The Institution of Engineers, Australia

ADVANCED BUILDING ENGINEERS PTY LTD
ABN 63 120 673 832 ACN 120 673 832
632 NEWCASTLE STREET, LEEDERVILLE, WA 6007.
T. 08 9228 4644, F. 08 9328 2937 www.abewa.com.au

DRAWING TITLE
SECOND FLOOR SUSPENDED SLAB PLAN
- BOTTOM REINFORCEMENT

PROJECT		APPROVED BY:		SHEET
DRAWN				S6
DESIGNED				REV
CHECKED		SCALE: 1:100		5