


BOTTOM REINFORCEMENT


SUSPENDED SLAB PLAN 1:100

1. MINIMUM SLAB THICKNESS 172mm UNLESS NOTED OTHERWISE
2. WET AREAS SETDOWN 20mm FOR TILING & FALLS (HATCHED).
3. DISTRIBUTION REINFORCEMENT, UNO: 172: N12 @ 300 UB
257: N12 @ 200 UB
4. ----- INDICATES BOTTOM REINFORCEMENT
5. ===== INDICATES LOAD BEARING BRICKWORK
----- INDICATES BRICKWORK ABOVE SLAB
6. FOR CONCRETE NOTES REFER TO COVER SHEET.
7. LB-LOWER BOTTOM REINFORCEMENT
UB-UPPER BOTTOM REINFORCEMENT
8. FOR COLUMN SIZE REFER TO SHEET 1
COLUMN SHOWN AS UNDER UNLESS NOTED OTHERWISE.
9. BUILDERS NOTE: ENSURE SUSPENDED SLAB NOTCHING
FOR ROOF RAFTERS IF REQUIRED.
(WHERE LOWER ROOF MEETS SUSPENDED SLAB.)

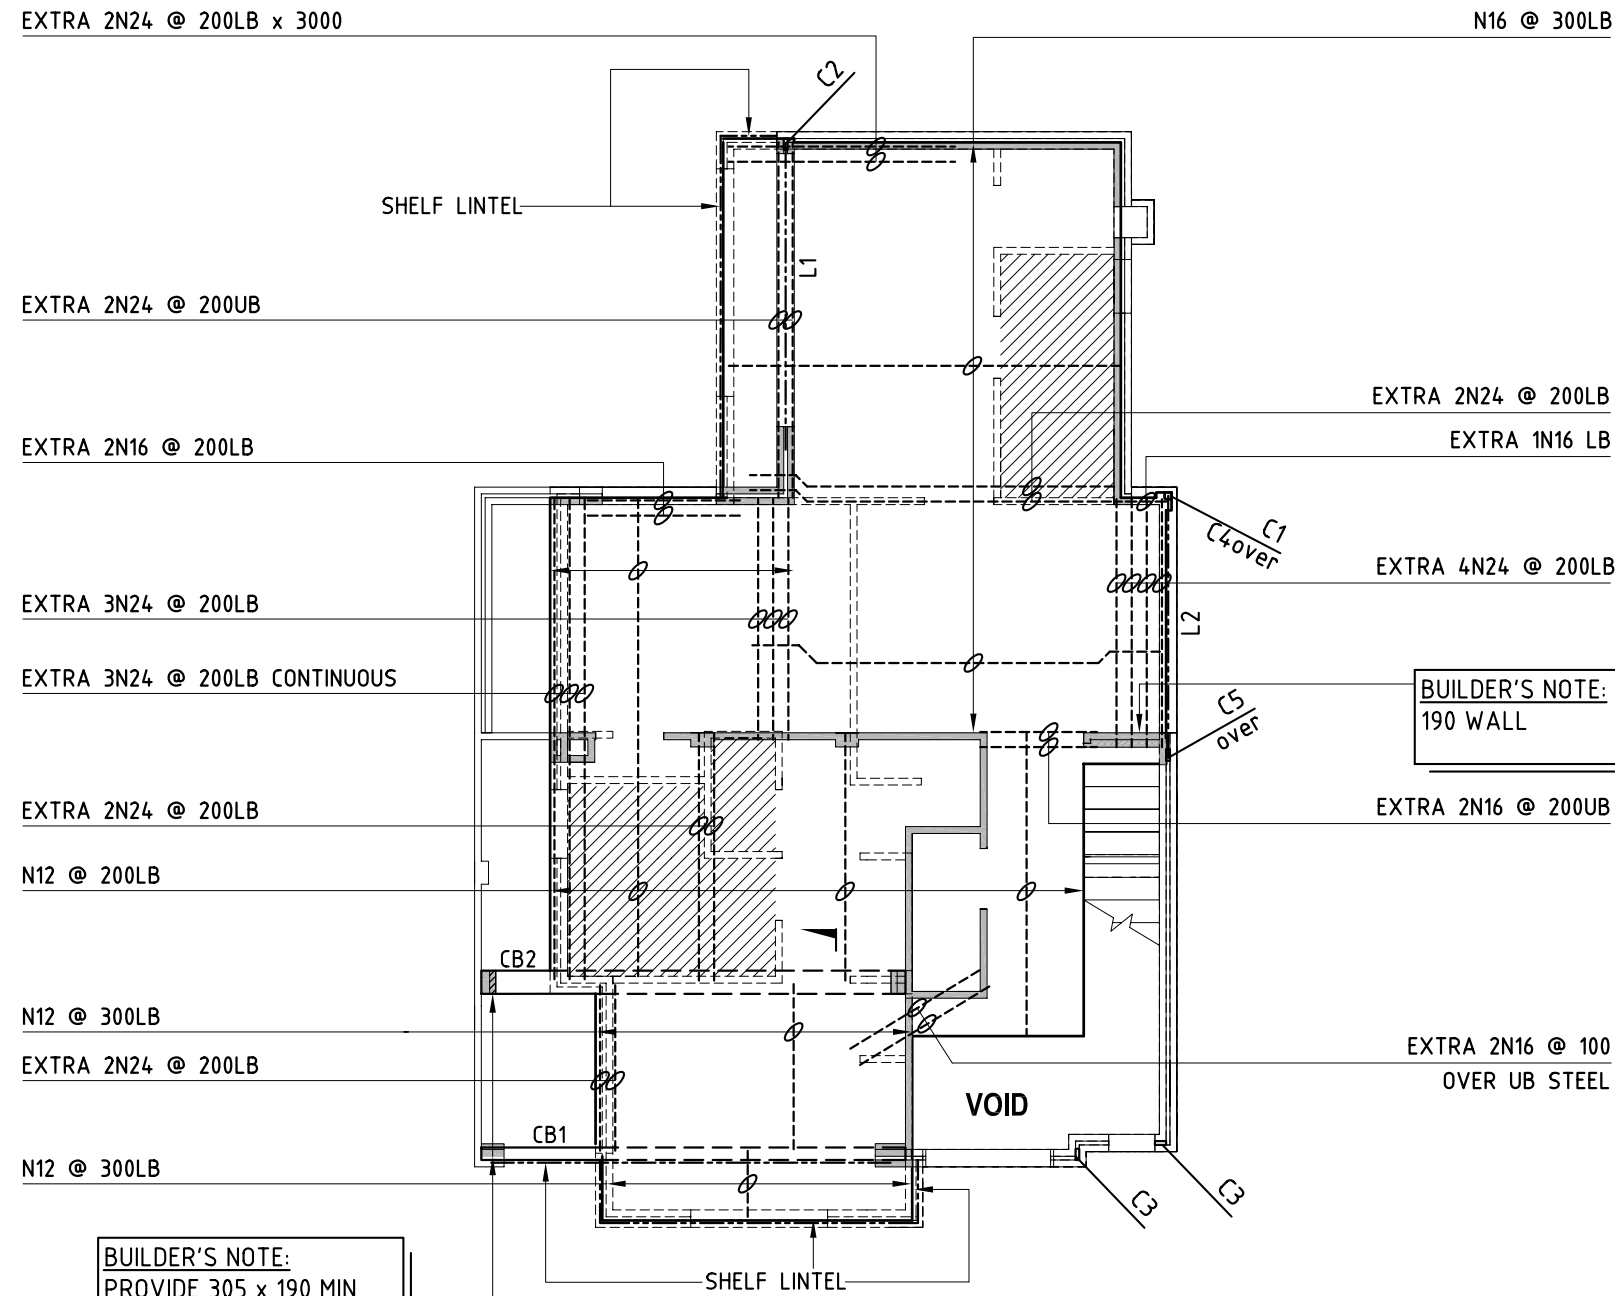


BUILDER'S NOTE:
190 WALL

BUILDER'S NOTE:
PROVIDE 305 x 190 MIN
BEARING TO EACH END
OF BEAM OVER (TYPICAL)



Robert David
MIEAust CPEng
Chartered Professional Engineer
Membership No. 259960
The Institution of Engineers, Australia

 <p>ADVANCED BUILDING ENGINEERS PTY LTD</p> <p>ABN 63 120 673 832 ACN 120 673 832</p> <p>632 NEWCASTLE STREET, LEEDERVILLE, WA 6007. T. 08 9228 4644, F. 08 9328 2937 www.abewa.com.au</p>	PROJECT												
	<p>DRAWING TITLE</p> <p>SUSPENDED SLAB PLAN - BOTTOM REINFORCEMENT</p>	<table border="1"> <tr> <td>DRAWN</td> <td></td> <td>APPROVED BY:</td> <td></td> </tr> <tr> <td>DESIGNED</td> <td></td> <td></td> <td></td> </tr> <tr> <td>CHECKED</td> <td></td> <td>SCALE: 1:100</td> <td></td> </tr> </table>	DRAWN		APPROVED BY:		DESIGNED				CHECKED		SCALE: 1:100
DRAWN		APPROVED BY:											
DESIGNED													
CHECKED		SCALE: 1:100											
			<p>SHEET S3 REV -</p>										